


Drainage - Soakaway Chamber Details

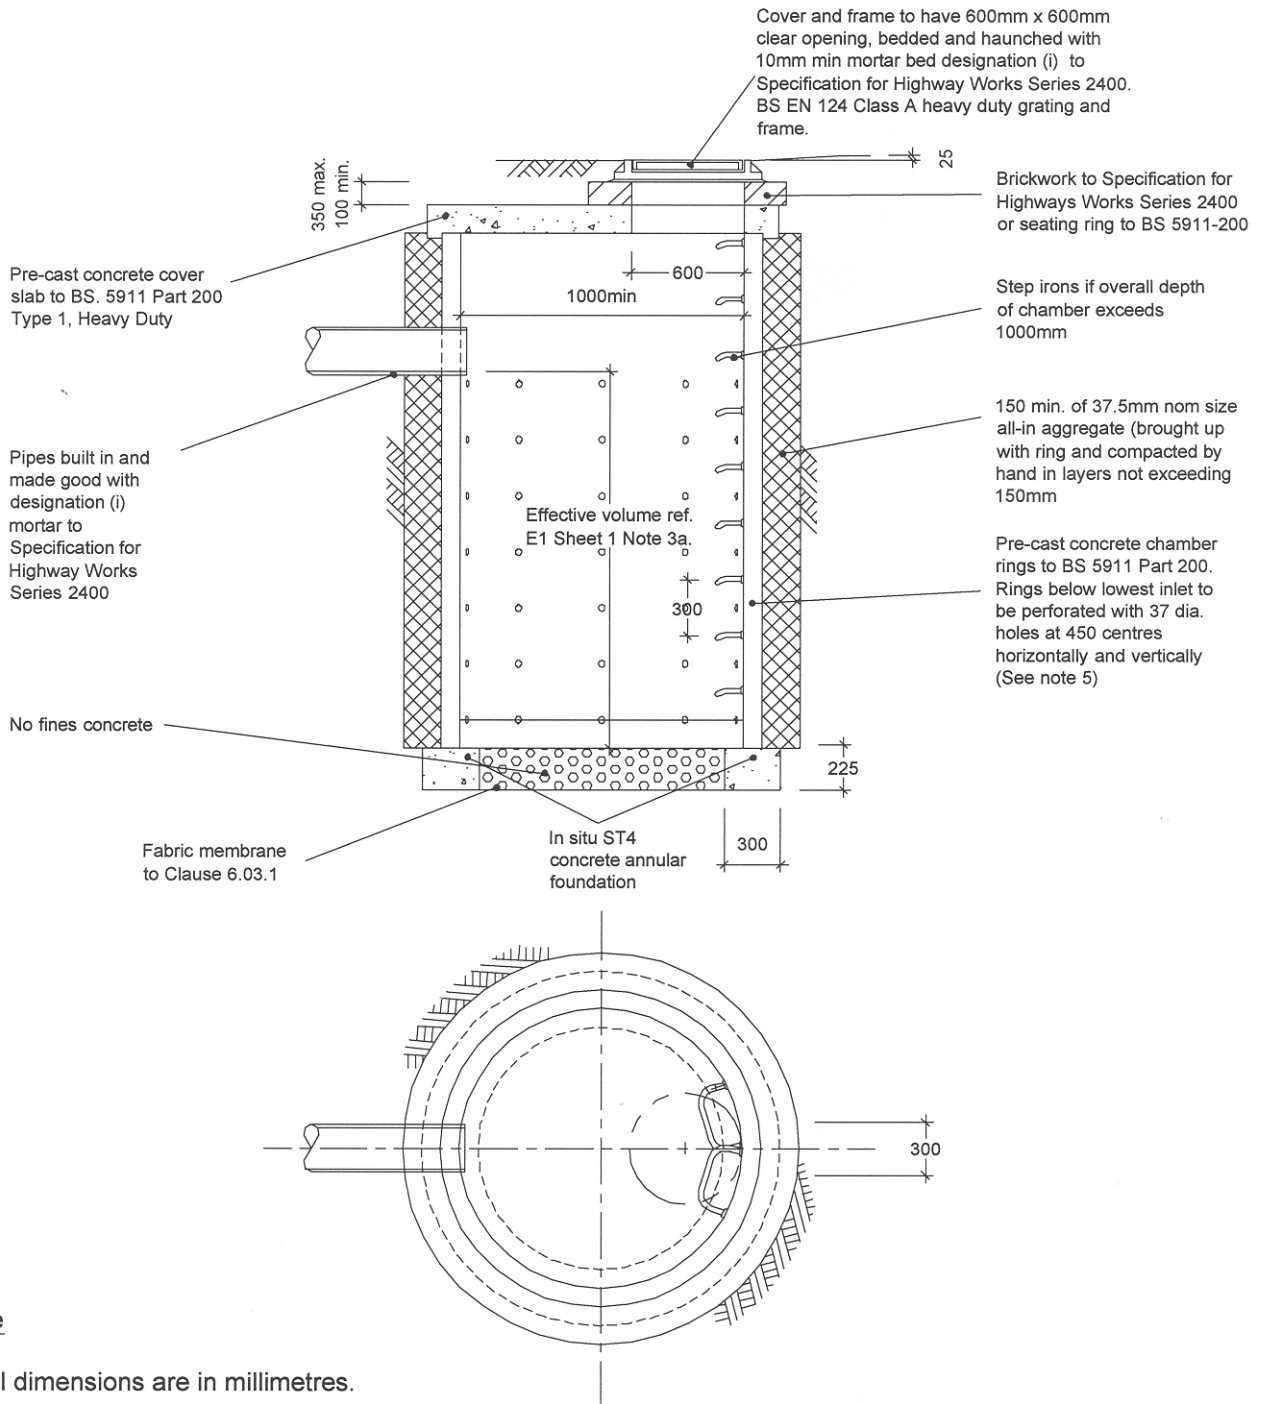

Note

1. All dimensions are in millimetres.
2. Rings to be placed centrally on annular concrete foundation.
3. Chamber walls and cover slab to be constructed in precast concrete to BS 5911-200
4. All ST concrete shall be to Specification for Highway Works, Clause 2602
5. At least one perforated ring must be provided, with more perforated segments required to match depth of permeable strata up to the pipe invert.